

Electric Signs


2019 California Electrical Code, Article 600 Electric Signs and Outline Lighting

Submit two color sets of sign and/or lighting plans (illuminated or non-illuminated signs) to the Livermore Permit Center for review; work may proceed upon permit being issued.

Minimum submittal requirements for sign fabrication and installation:

- Disconnect required on exterior at sign
- Disconnect Required at transformer
- Bond all components
- Sign (components) to be anchored to the building structure – Not the fascia or other non-structural members
- U.L. listing (or other approved agency listing) and labeling required on all sign components
- Vendor, voltage, and amperage label required
- Monument signs six feet or more in height require footing and structural inspections, also structural calculations may be required
- Provide site plans showing sign locations

Sample Installation Detail

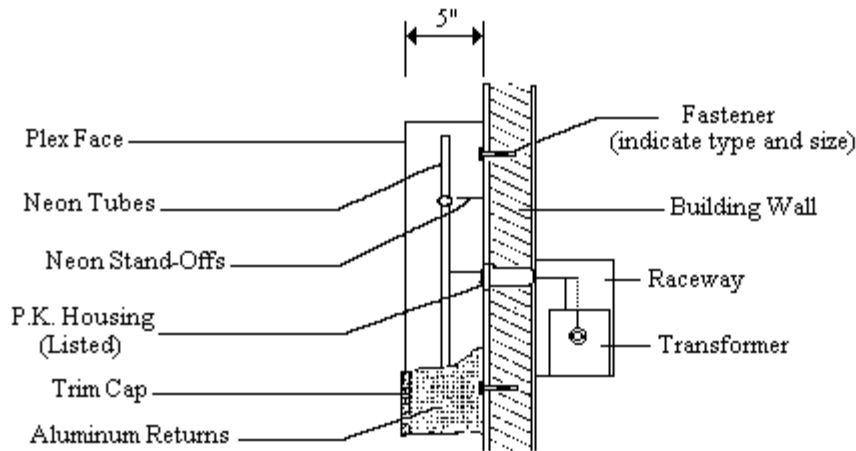

Letters Mounting Detail (U.L. Listed)

NOT TO SCALE

Note: All signs require Planning approval prior to Building permit submittal

[Inset link to Planning sign approvals](#)

Updated 2-4-2020